

# *XMH* 承認書

## SPECIFICATION FOR APPROVAL

客戶(Customer):

客戶料號(Customer P/N):

样品編號(Supplier P/N):

機種型號(Model No.):

品名(Description):

規格(Specification):

RH-3020008G-16

喇叭

3020 MYLAR 8 欧 1.5W 环保

客戶承認欄 (Customer Authorization Signature)	供應商 (Supplier Audit)		
	審核	檢查	作成
		魏秀琼	冉雷
	日期: 2017 年 08 月 02 日 版次: A0		

### **XIAMEN HONCH INDUSTRIAL SUPPLIERS CO LTD**

Tel: +86-592-5020537 Fax: +86-592-5020137

<http://www.honch-ind.com>


E-mail:rogeryu@honch-ind.com

# XIAMEN HONCH INDUSTRIAL SUPPLIERS CO LTD

Tel: +86-592-5020537 Fax: +86-592-5020137

<http://www.honch-ind.com> rogeryu@honch-ind.com

1	Model	RH-3020008G-16
2	Dimension	Outline Dimension Shall Be As Shown In Fig(1).
3	Weight	Approx 8.2 Grams.
4	Magnet	Materials Nd-Fe-B
5	Impedance	$8 \pm 15\%$ ohm At 1000Hz/1v.
6	Power Rating	Normal 1.5W. Maximum 1.75W.
7	Lower Resonant Frequency	$800 \pm 20\%$ HZ
8	Output Sound Pressure Level (S.P.L)	$96 \pm 3$ db/1 Watt, 0.1Meter. At 800, 1000, 1200, 1500Hz. Measurement Method Shown In Fig(2).
9	Frequency Range	F0~5KHz. Average SPL-10db. Shown In Fig(3).
10	Distortion	5% Maximum At 1000Hz. 1.5W.
11	Abnormal Sound Test	Must Be Normal By 3.46 Volts. Sine Wave.
12	Polarity	Diaphragm Shall Move Forward When Apply a Positive DC Current To The "+" or "marked" Terminal.
13	Operating Temperature	-20°C to +50°C
14	Storage Temperature	-25°C to +55°C

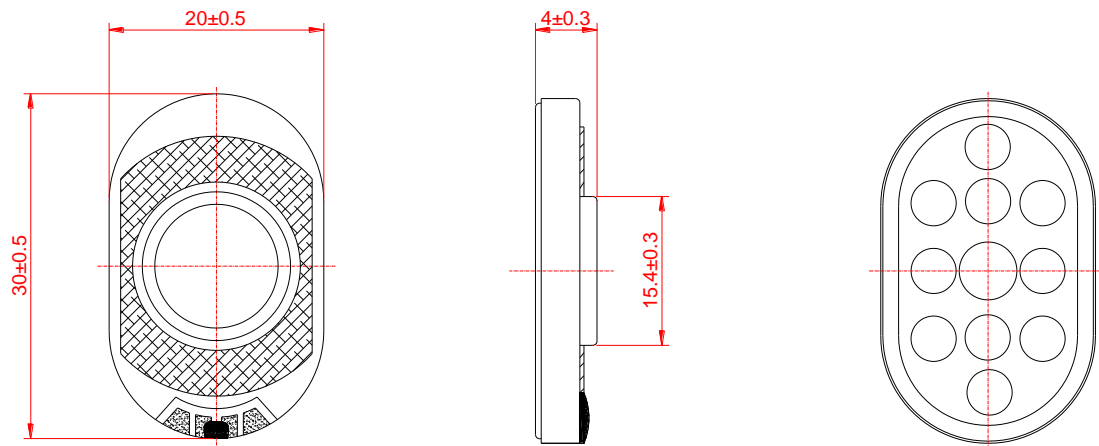


Unit:mm Tolerance:  $\pm 0.3$

# XIAMEN HONCH INDUSTRIAL SUPPLIERS CO LTD


Tel: +86-592-5020537 Fax: +86-592-5020137

<http://www.honch-ind.com> rogeryu@honch-ind.com

Test baffle Diagram

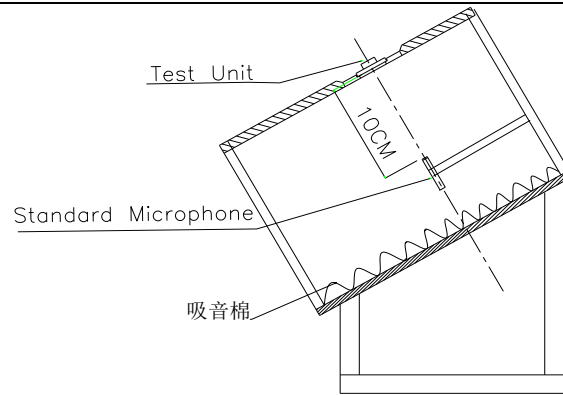

Frequency Response Fig(3).

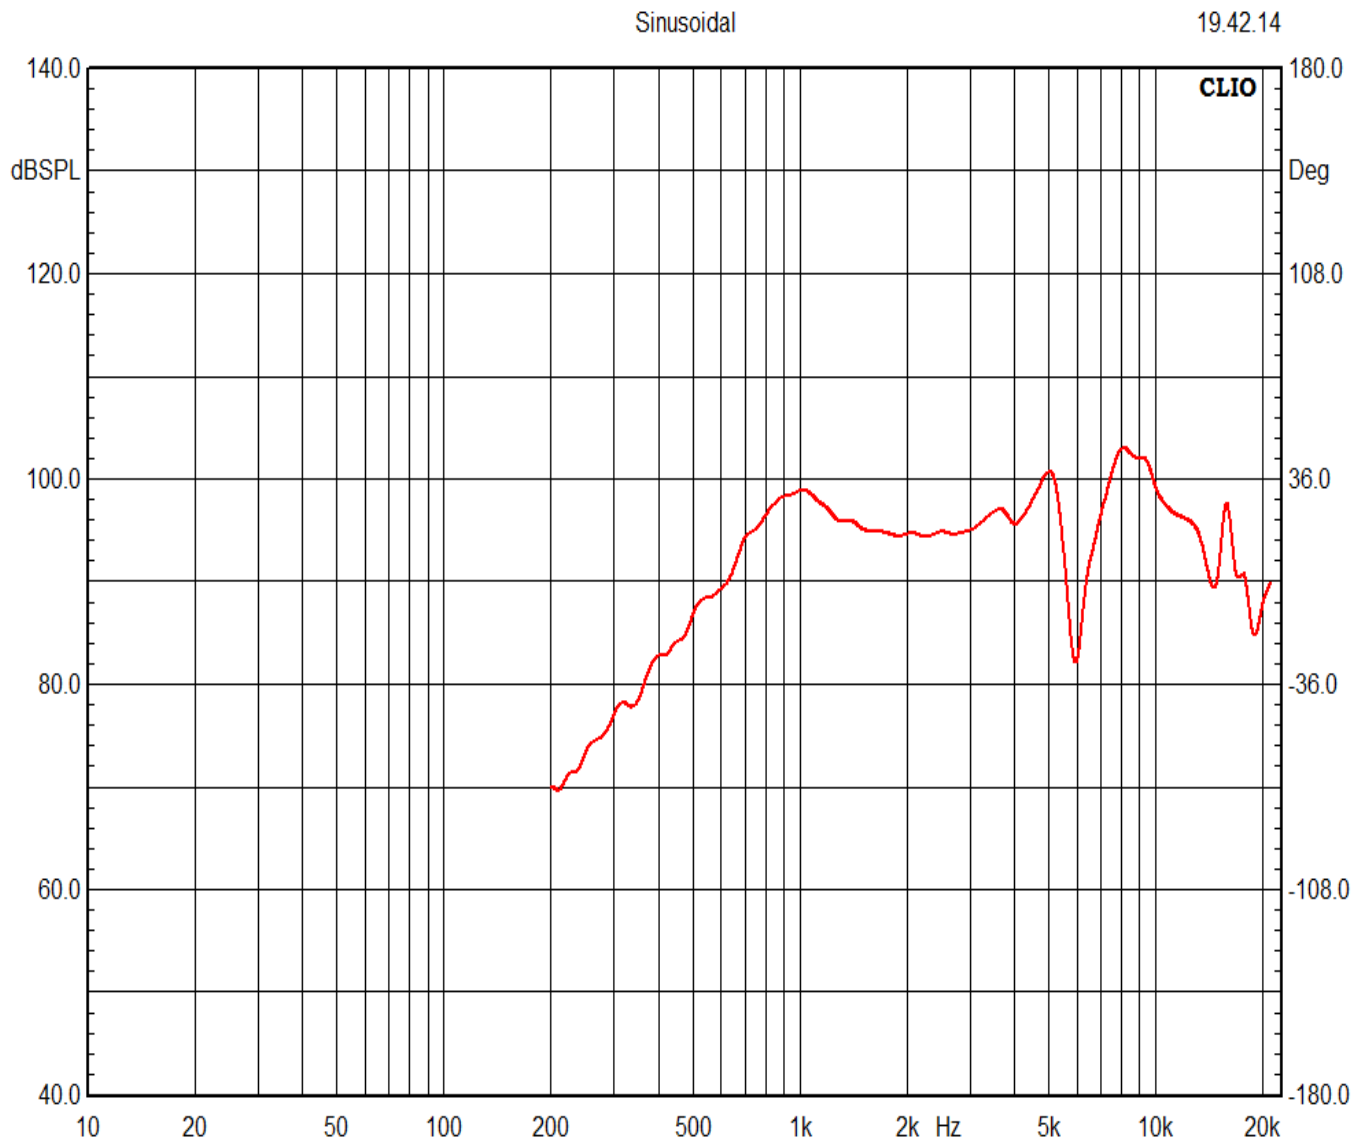

JUT-3020008G-16 1 W 10CM

# XIAMEN HONCH INDUSTRIAL SUPPLIERS CO LTD

Tel: +86-592-5020537 Fax: +86-592-5020137

<http://www.honch-ind.com> rogeryu@honch-ind.com

## Reliable Test

After any following test leave speakers at room temperature for 1 hour, SPL shall not deviate by  $\pm 3$  db from initial value

15-1	Load Test	White noise for 24 hours at 1.5W input power.
15-2	High Temperature Test	+50 $\pm$ 2 °C 24hours
15-3	Low Temperature Test	-20 $\pm$ 2 °C 24hours
15-4	Humidity Test	+40 $\pm$ 2 °C relative humidity 90~95%R.H 24 hours
15-5	Vibration Test	Frequency 30 $\pm$ 15 Hz, Amplitude 1.5 mm for 2 Hours per axis(x. y. z axis)
15-6	Drop Test	75 CM free falling on Concrete floor, 10 times.
15-7	Temperature Cycle test	-20~ + 50°C 5 Cycles Temperature test.

